


Notes:

1. All saw cuts to be full depth.
2. Patch material shall match the existing pavement material (eg. PCC pavement shall be patched with PCC and existing asphalt pavement with asphalt).
3. For asphalt patches base course & asphalt concrete thickness to match existing but in no case will be less than 6" base & 5" asphalt concrete. The existing vertical asphalt face shall be tacked.
4. For PCC pavement patches - see Section 40 details.
5. PCC pavement removals shall be per Section 40 details.
6. Trenches are shown to diagram patching requirements and at a minimum meet the minimum trench width table below. Trenches shall be constructed to meet OSHA requirements.
7. Pavement removal between first and second saw cut shall be removed at time of patching.

Pipe Diameter	Minimum Width
<8 in.	24"
8in. - 12in.	30"
14in. - 18in.	36"
20in. - 21in.	42"
24in. - 36in.	1.25 (Pipe O.D.) Plus 12in.
>36in.	Per Plans

N.T.S.

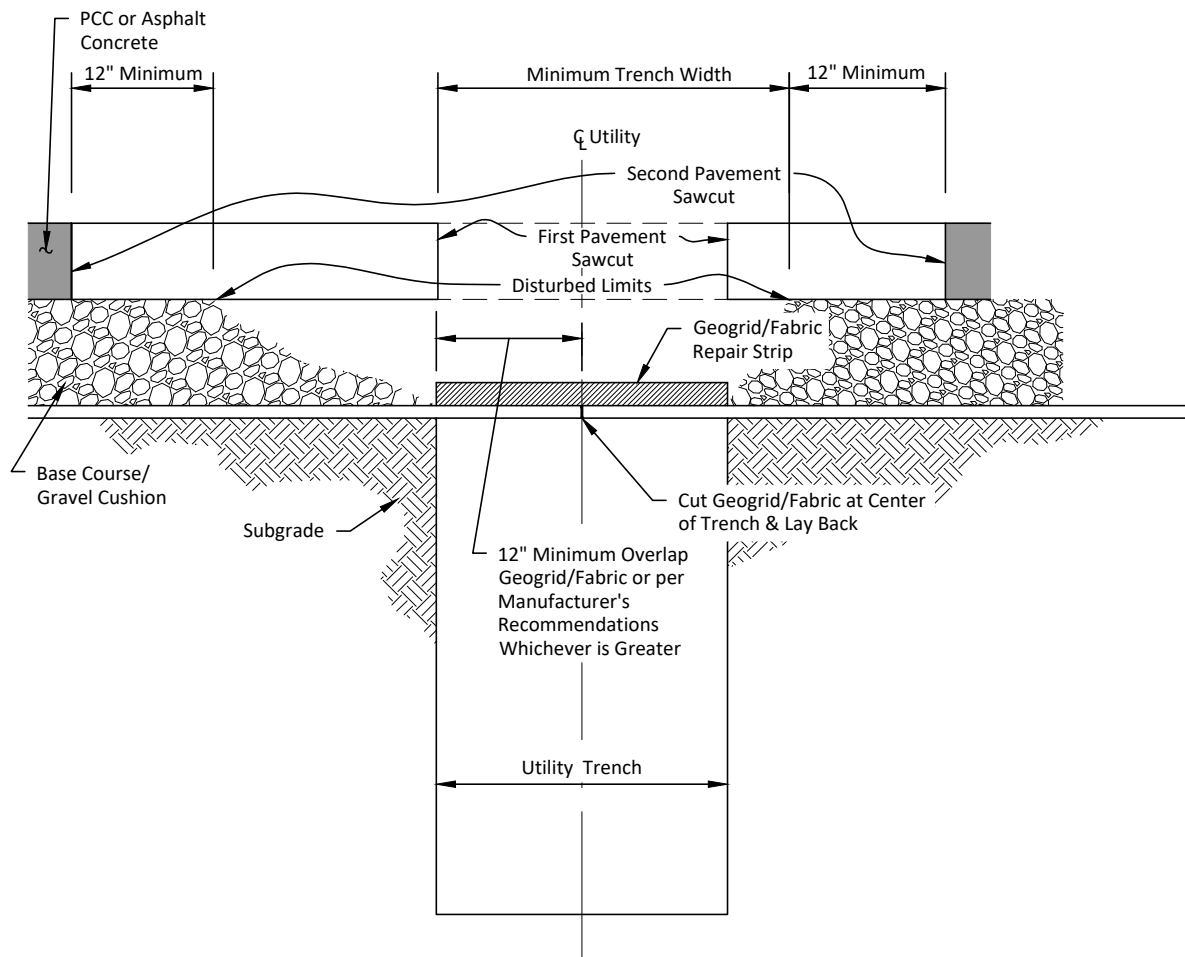

Notes:

1. All saw cuts to be full depth.
2. Patch material shall match the existing pavement material (eg. PCC pavement shall be patched with PCC and existing asphalt pavement with asphalt).
3. For asphalt patches base course & asphalt concrete thickness to match existing but in no case will be less than 6" base & 5" asphalt concrete. The existing vertical asphalt face shall be tacked.
4. For PCC pavement patches - see Section 40 details.
5. PCC pavement removals shall be per Section 40 details.
6. Trenches are shown to diagram patching requirements and at a minimum meet the minimum trench width table below. Trenches shall be constructed to meet OSHA requirements.
7. Pavement removal between first and second saw cut shall be removed at time of patching.

Pipe Diameter	Minimum Width
<8 in.	24"
8in. - 12in.	30"
14in. - 18in.	36"
20in. - 21in.	42"
24in. - 36in.	1.25 (Pipe O.D.) Plus 12in.
>36in.	Per Plans

N.T.S.

GEOGRID/FABRIC UTILITY TRENCH PATCH DETAIL